

Annual Groundwater Monitoring and Corrective Action Report

**CPS Energy
Calaveras Power Station – Bottom Ash Ponds
San Antonio, Texas**

January 2022

www.erm.com



TABLE OF CONTENTS

1. CURRENT STATUS SUMMARY..... 1
2. INTRODUCTION.....2.....INTRODUCTION.....T41.Tf0g01PROGRAM...78.2

3.1 GROUNDWATER OBSERVATIONS

Depth to groundwater surface measurements were made at each monitoring well prior to sampling. Groundwater elevations were calculated by subtracting the depth to ground-water measurement from the surveyed reference elevation for each well. Groundwater elevations collected during the monitoring events are summarized in Table 1. Groundwater elevations

4. *STATISTICAL ANALYSIS AND RESULTS*

Consistent with the CCR Rule and with the SAP,

A total of three well-analyte combinations were found to have either increasing or decreasing trends. For these well-analyte pairs, a bootstrapped UPL calculated around a Theil Sen trend was used to derive a more accurate UPL. The remaining ten well-analyte combinations were found to have no significant trend. Sanitas was used to calculate static UPLs using an annual site-wide false positive rate of 0.1 with a 1-of-2 re-testing approach.

A final UPL was selected for each analyte and compared to the most recent sample result in each downgradient well. For pH, a final lower prediction limit (LPL) was also identified and used for comparison. For the one analyte with interwell analysis, the upgradient dataset was pooled prior to UPL calculations, resulting in a single UPL value per analyte. For the six analytes with intrawell analysis, a UPL value was calculated for each of the upgradient wells. For these wells and analytes, the maximum UPL was selected as the representative UPL for each analyte. A similar approach was used to determine the LPL for pH; however, the minimum LPL was selected in the case of intr

Tables

TOC Elevation

498.63

TOC Elevation

496.92

TOC Elevation

12/6/16 to 2/21/17 to 3/28/17 to 5/2/17 to 6/20/17 to 7/25/17 to 8/29/17 to 10/10/17 to 4/4/18 to 10/30/18 to 4/9/19 to 10/22/19 to 4/28/20 to 10/20/20 to 4/13/21 to 10/19/21 to
12/8/16 2/23/17 3/30/17 5/4/17 6/21/17 7/26/17 8/30/17 10/11/17 4/5/18 10/31/18 4/10/19 10/23/19 4/29/20 10/21/20 4/14/21 10/20/2021

JKS-48

TABLE 3

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

Constituents	Unit
Boron	mg/L
Calcium	mg/L
Chloride	mg/L
Fluoride	mg/L
Sulfate	mg/L
pH - Field Collected	SU
Total dissolved solids	mg/L

TABLE 3
Groundwater Analytical Results Summary

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

Constituents	Unit
Boron	mg/L
Calcium	mg/L
Chloride	mg/L
Fluoride	mg/L
Sulfate	mg/L
pH - Field Collected	SU

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

Constituents	Unit
Boron	mg/L
Calcium	mg/L

Figures

2021 Water Level Study Report
Appendix A

Annual Groundwater Monitoring and Corrective Action Reports have been completed for each of

TABLE 1
 Groundwater Elevations Summary - CCR Unit Wells
 CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water (ft btoc)	Water Level (ft msl)
JKS-45 Upgradient	FAL	531.46	1	12/6/2016	46.83	484.63
JKS-45 Upgradient	FAL	531.46	2	2/21/2017	46.64	484.82
JKS-45 Upgradient	FAL	531.46	3	3/28/2017	46.52	484.94

TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water (ft btoc)	Water Level (ft msl)

TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station




TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date
------	----------	----------------------------	--------------	------

TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water
------	----------	----------------------------	--------------	------	----------------

TABLE 1
 Groundwater Elevations Summary - CCR Unit Wells
 CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water (ft btoc)	Water Level (ft msl)
JKS-61 Downgradient	EP	505.51	1	12/6/2016	23.95	481.56
JKS-61 Downgradient	EP	505.51	2	2/21/2017	23.31	482.20
JKS-61 Downgradient	EP	505.51	3	3/28/2017	23.10	482.41
JKS-61 Downgradient	EP	505.51	4	5/2/2017	22.85	482.66
JKS-61 Downgradient	EP	505.51	5	6/20/2017	22.05	483.46
JKS-61 Downgradient	EP	505.51	6	7/25/2017	23.50	482.01
JKS-61 Downgradient	EP	505.51	7	8/29/2017	23.60	481.91
JKS-61 Downgradient	EP	505.51	8	10/10/2017	23.97	481.54
JKS-61 Downgradient	EP	505.51	9	4/4/2018	23.08	482.43
JKS-61 Downgradient	EP	505.51	10	10/30/2018	23.94	481.57
JKS-61 Downgradient	EP	505.51	11	4/9/2019	22.97	482.54
JKS-61 Downgradient	EP	505.51	12	10/22/2019	24.20	481.31
JKS-61 Downgradient	EP	505.51	13	4/23/2020	23.74	481.77
JKS-61 Downgradient	EP	505.51	14	10/15/2020	24.60	480.91




TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water (ft btoc)	Water Level (ft msl)
------	----------	----------------------------	--------------	------	-----------------------------	-------------------------

TABLE 1
Groundwater Elevations Summary - CCR Unit Wells
CPS Energy - Calaveras Power Station

Well	CCR Unit	Well Elevation (ft msl)	Event No.	Date	Depth to Water
------	----------	----------------------------	--------------	------	----------------

ervation Wells
Wells







TABLE G
Groundwater Elevations Summary - Non-CCR Unit Observation Wells
CPS Energy - Calaveras Power Station


Well	Well Elevation (ft msl)	Event No.	Date	Depth to Water (ft btoc)	Water No. (ft msl)
------	----------------------------	--------------	------	-----------------------------	--------------------------

FIGURES




DESIGN:	DRAWN:	CHKD.:
DATE:	SCALE:	REVISION:







DATE:		




DATE:		



DATE:		



DATE:		



DATE:		

E1

E3 E4 E5

E7 E8

E9

E10

E11

E12

E13

E14

E17 E18 E19

E15

E17

E18

E1 E2 E4 E5 E6 E7 E8

E9

E10

E12

E13

E14

E15

E17 E18 E19

E16

E17

E19

Laboratory Data Packages

Appendix B

(Data Packages Available Upon Request)

Statistical Analysis Tables and Figures

Appendix C

Appendix C Table 1
Kruskal Wallis Test Comparisons of Upgradient Wells
Calaveras Power Station
Bottom Ash Ponds

Analyte	N	N
---------	---	---







Appendix




Appendix 7 – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

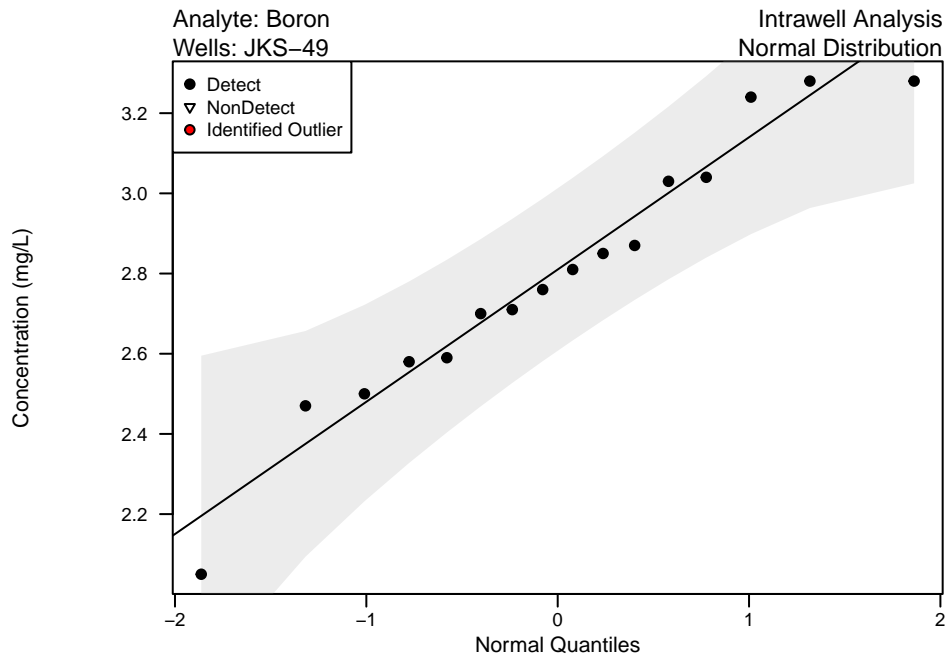

Intentionally left blank,
not Lognormal/NDD distribution.

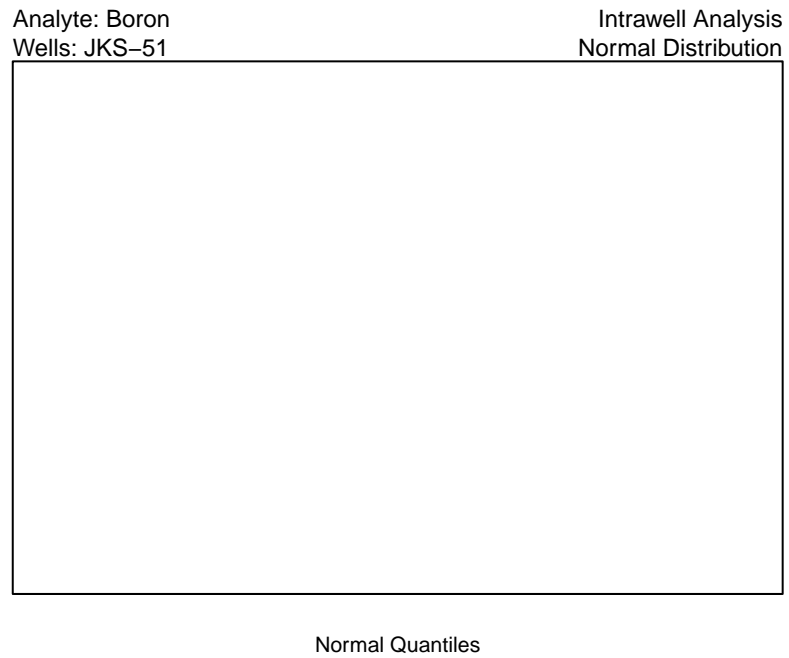


Appendix 7 – Figure 2
Unit: Bottom Ash Ponds'
QQ Plots of Upgradient Wells

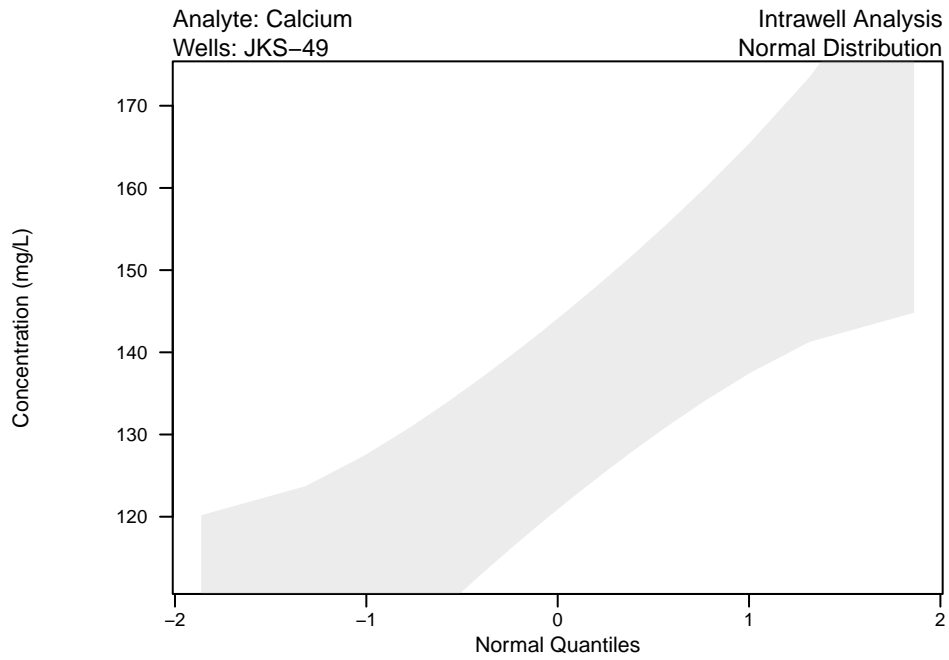

Appendix 7 – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

Analyte: Chloride
Wells: JKS-49, JKS-51




Appendix 7 – Figure 2
Unit: Bottom Ash Ponds

Appendix 7 – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

Analyte: pH
Wells: JKS-51


Intrawell Analysis
NDD Distribution

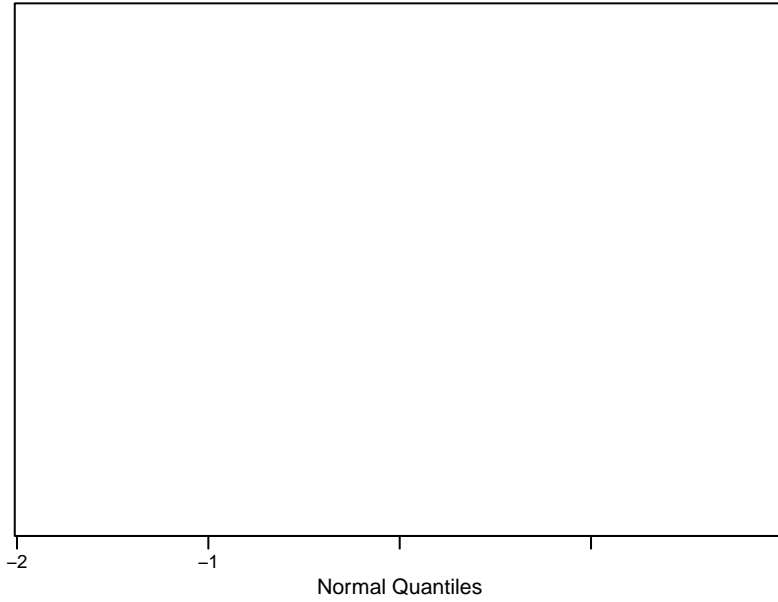

Appendix 7 – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

Analyte: Total dissolved solids
Wells: JKS-51


Intrawell Analysis
Normal Distribution



Normal Quantiles

Appendix 7 – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells

Chemical: Boron
Significant Difference (Intrawell Analysis)

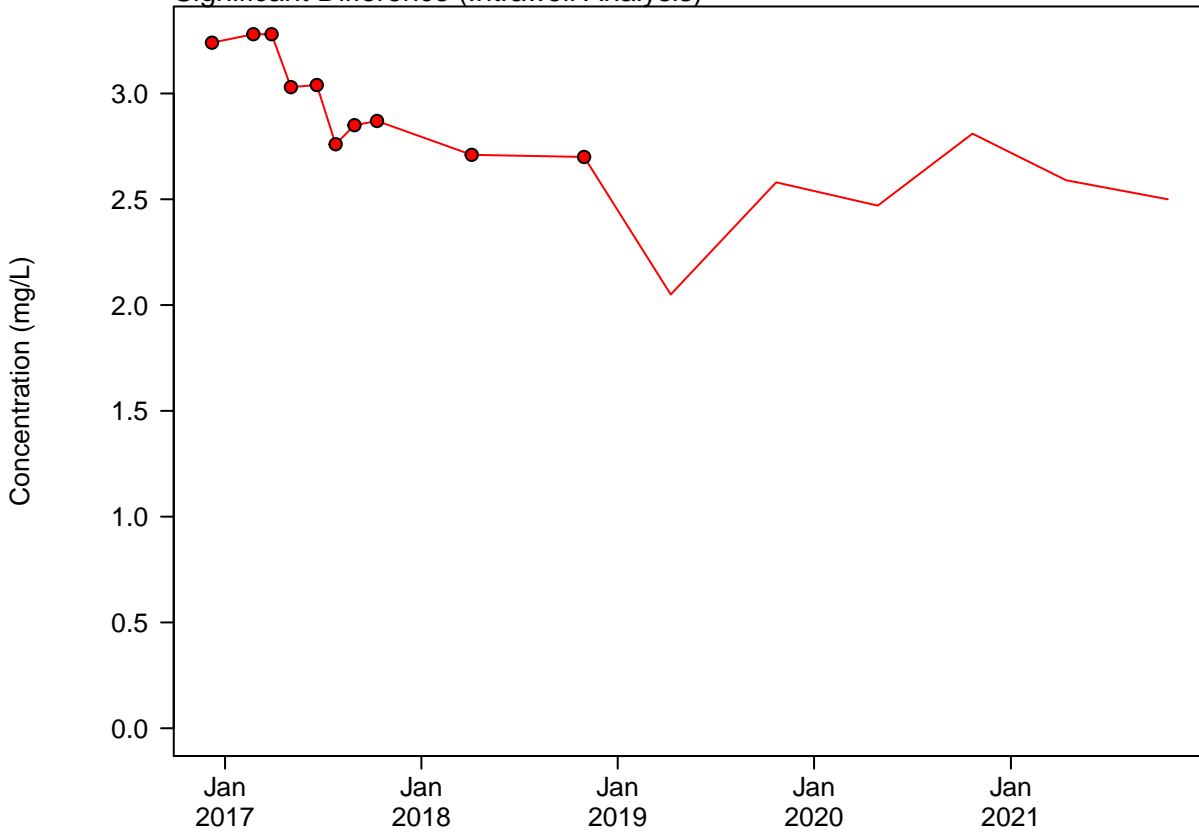

Appendix 7 – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells

Chemical: Chloride

No Significant Difference (Interwell Analysis)



Jan
2017

Jan
2018


Jan
2019

Jan
2020

Jan
2021

Appendix 7 – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells


Chemical: pH
Significant Difference (Intrawell Analysis)

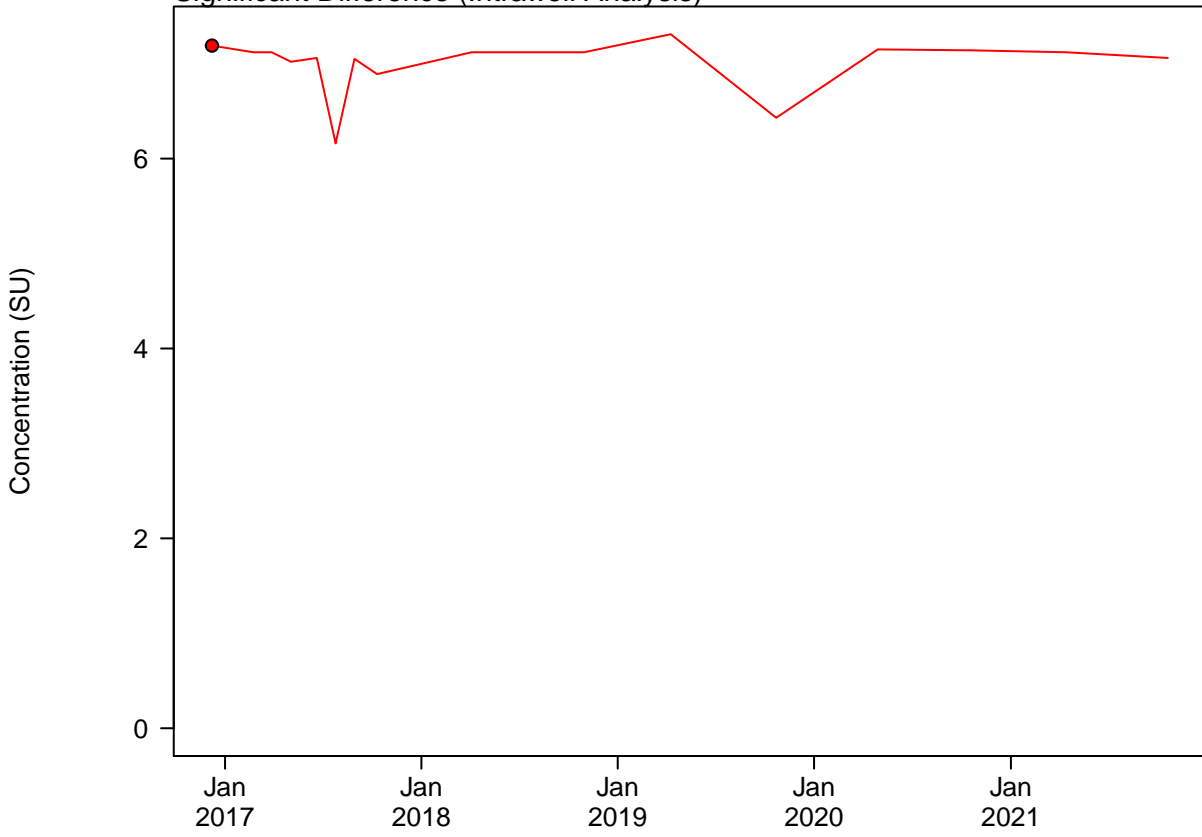

Appendix 7 – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells


Appendix 7 – Figure 4
Unit: Bottom Ash Ponds
Trend Analysis of Downgradient Wells with Exceedances

Chemical: Boron
Well: JKS-50R

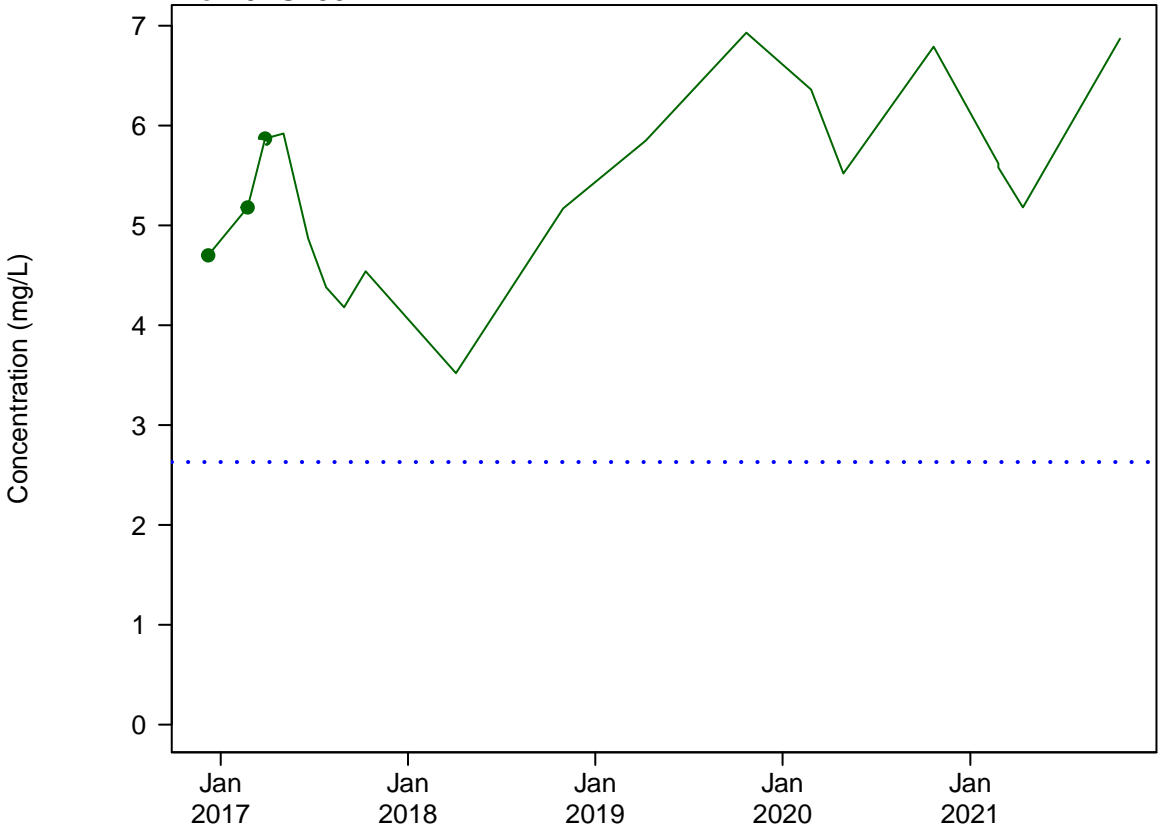

Appendix 7 – Figure 4
Unit: Bottom Ash Ponds
Trend Analysis of Downgradient Wells with Exceedances

Chemical: Fluoride



**April 2021 Groundwater Sampling Event and
August 2021 Resampling Event –
Calaveras Power Station CCR Units**

Appendix D

ERM

ATTACHMENT 1

**APRIL AND AUGUST 2021 GROUNDWATER
SAMPLE RESULTS**



Constituent	Units	2020 LPL - BAP	2020 UPL - BAP	BAP	BAP	BAP	BAP	BAP
				Downgradient JKS-48 4/13/2021 N	Downgradient JKS-50R 4/13/2021 N	Downgradient JKS-52 4/13/2021 N	Downgradient JKS-55 4/13/2021 N	Downgradient JKS-56 4/13/2021 N
Boron	mg/L	--	2.65	2.19	5.18	2.51	0.762	3.16
Calcium	mg/L	--	387	140	139	209	146	111
Chloride	mg/L	--	607	477	110	470	440	176
Fluoride	mg/L	--						

Constituent	Units	2020 LPL - SRH	2020 UPL - SRH	SRH Pond Downgradient JKS-52 4/13/2021 N	SRH Pond Downgradient JKS-53 4/13/2021 N	SRH Pond Downgradient JKS-54 4/13/2021 N
Boron	m					